

TCCWD January 2025

Operators Report

Presented: 2/22/2025



January 2025:

Plant Production:	330,593	100%	Production Meter	10,664
Homeowners:	141,253	43%	% of Production	4,557
Timber Cove Inn:	71,702	22%	% of Production	2,313
Non-Billable Operational useage:	32,500	10%	% of Production	1,048
TCCWD meter	20,000	62%	% of operational useage	
Backwashing Filters	12,500	38%	% of operational useage	
Non-Billable Distribution Useage:	66,687	20%	% of Production	
Water Used from Hydrants (Flushing)	10,000	15%	% of secondary useage	
Water hidden within tanks	55,187	83%	% of secondary useage	
TCFPD- Fire department	1500	2%	% of secondary useage	
Primary: unaccountable, non-billable loss	18,451	6%	% of production	
Operational usage- Returned to Reservoir:	71,000	218%	% of Operational useage	Includes Raw

This month we produced 330,593 gallons and sold 65% of it at 212,955 gallons. Very similar numbers to last month with the primary difference being more water produced for flushing and tank storage.

January 2025: Erosion Concerns/Difficulties Continue




January 2025: Erosion Concerns/Difficulties Continue



January 2025: Erosion Concerns/Difficulties Continue



What the..

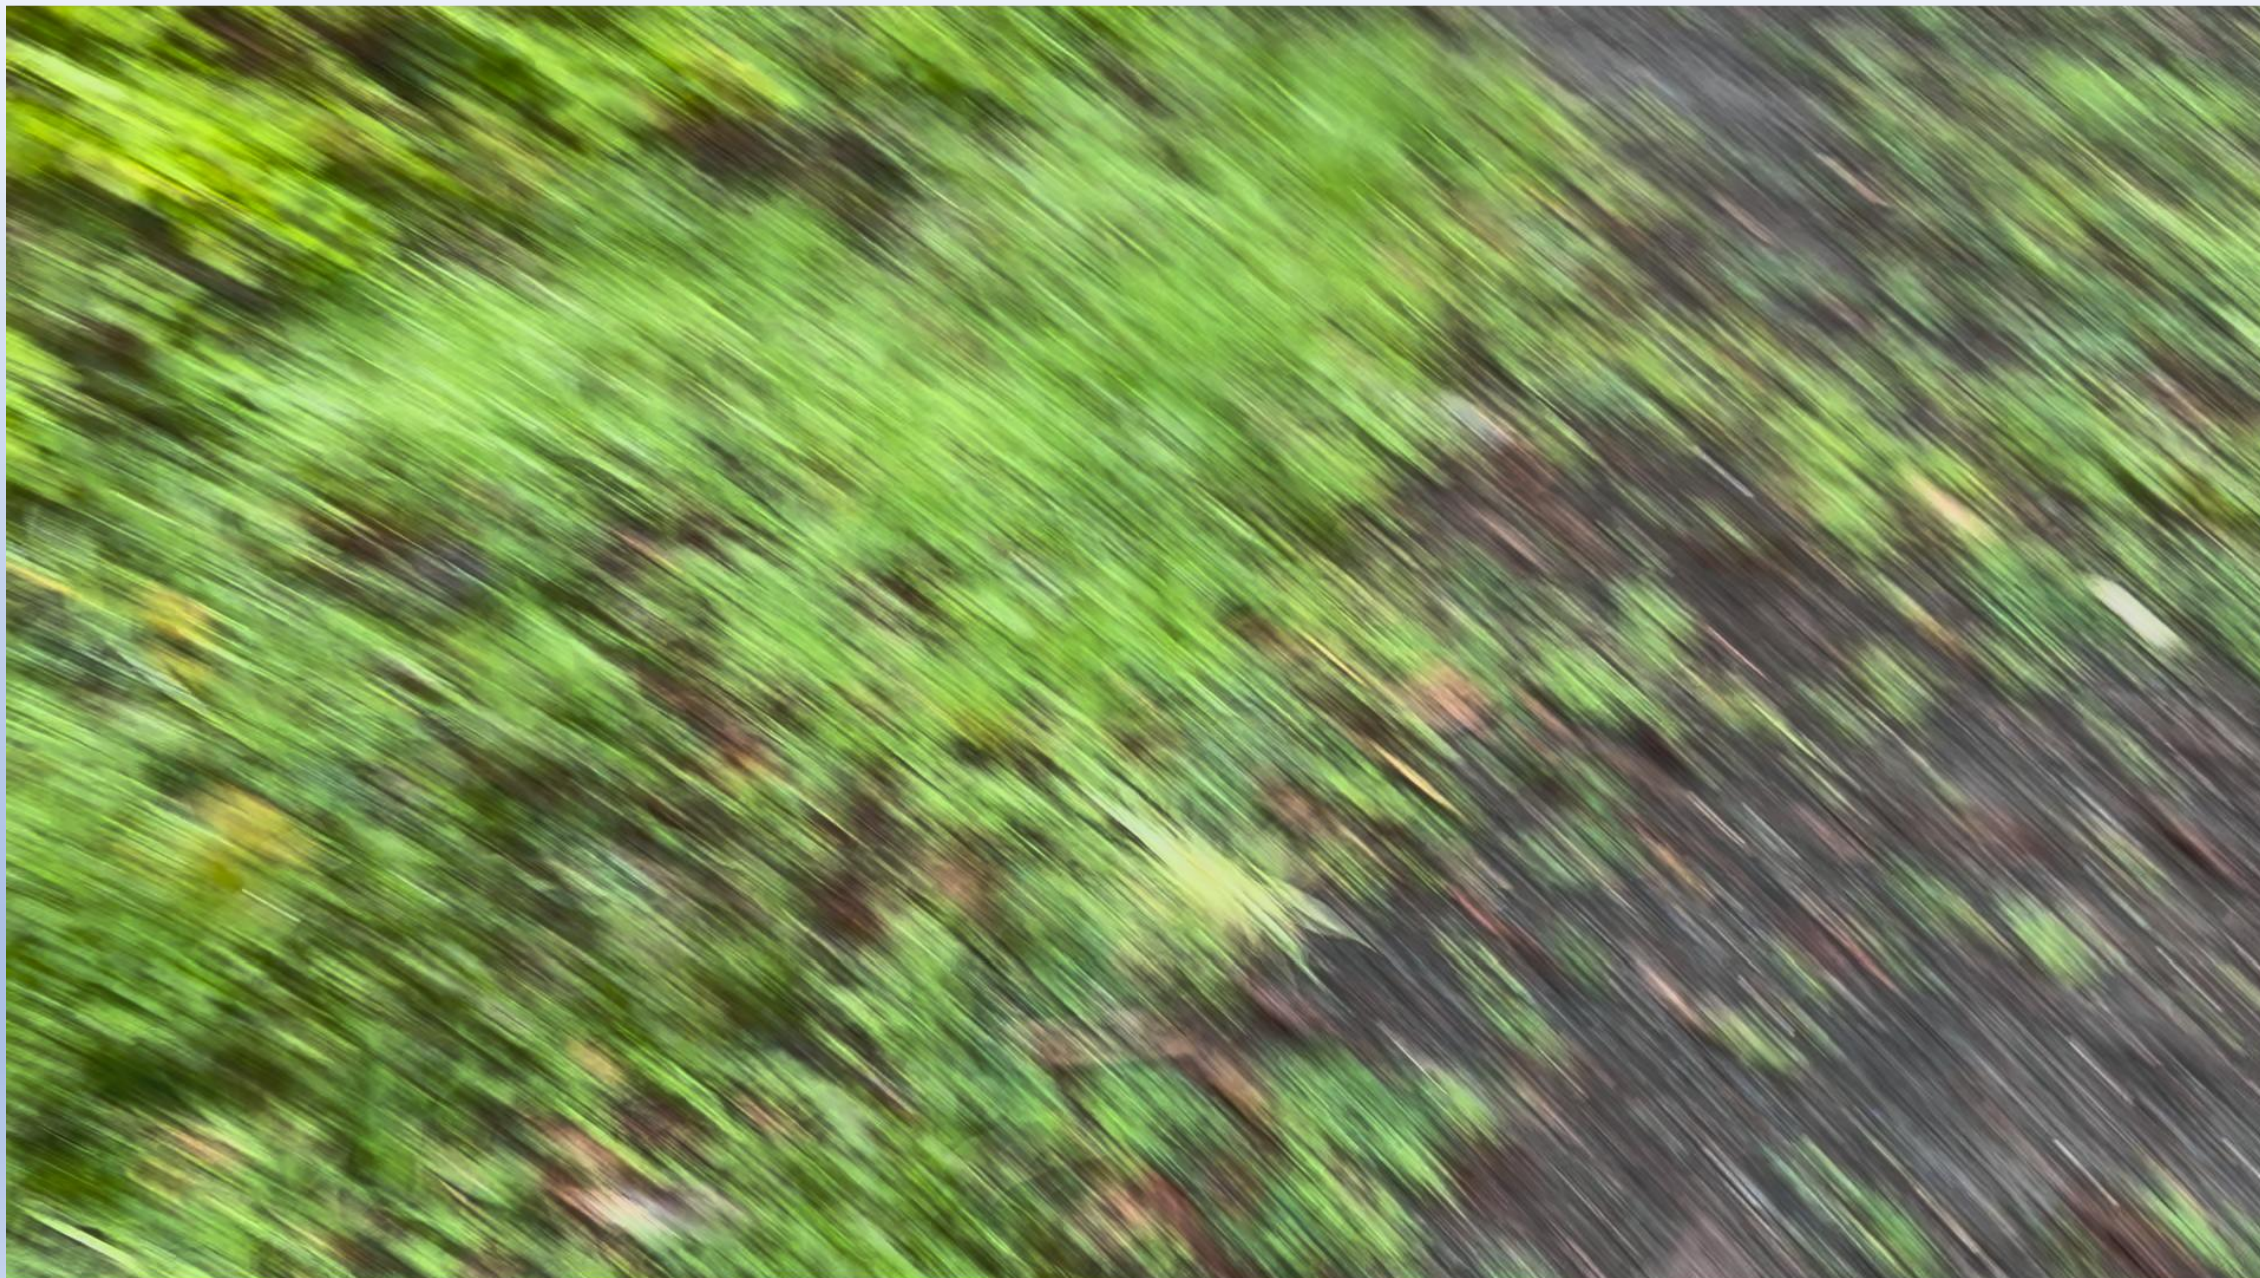

Cross Connection Control:

https://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/cccp.html

The Cross-Connection Control Policy Handbook (CCCPH) took effect July 1, 2024.

3.1.4 Plan for Public Water System Cross-Connection Control

(a) After adoption of the CCCPH, each PWS must submit a written Cross-Connection Control Plan for State Water Board review in accordance with the following schedule:

(1) An Existing PWS must submit the Cross-Connection Control Plan no later than 12 months after the effective date of the CCCPH.

Cross-connection Control Plan Template for Community Water Systems (CWS) serving 200-999 connections – Expected 1Q-2025

Backflow prevention devices are required for wells, storage tanks, irrigation systems, etc..

Our current policy is under our Standing Rules + Regs Section 5. We will need to submit our updated policy to the SWRCB by July 1st, 2025 although they have not yet finished the template for systems of our size as noted above.

Public Service Announcements:

Call 811 Before You Dig

<https://www.usanorth811.org/>

It's The Law:

California Government Code 4216 TITLE 1. GENERAL [100 - 7914] DIVISION 5. PUBLIC WORK AND PUBLIC PURCHASES [4000 - 4563] CHAPTER 3.1. Protection of Underground Infrastructure [4215 - 4216.24] ARTICLE 2. Regional Notification Center System [4216 - 4216.24]

